


TANZANIA NATIONAL ROADS AGENCY

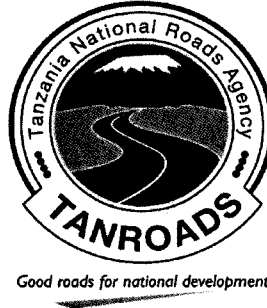

P.O. Box 11364
3rd Floor
Airtel House
Ali Hassan Mwinyi / Kawawa Roads
Junction
Dar es Salaam

Date: 15th August 2017

Our Ref: TRD/HQ/GEN/845/01

To: All Prospective Bidders

RE: UPGRADING OF MBINGA – MBAMBA BAY ROAD (66 KM) TO BITUMEN STANDARD, TENDER NO. AE/001/2015 – 16/HQ/W/54

Sub: Clarification No. 2 to the Bidding Documents


Please refer to the above subject.

Pursuant to Sub-Clause 7.1 of the Instructions to Bidders (ITB) of the Bidding Documents, TANROADS issues the attached Clarification No. 2 to the Bidding Documents.


Ephrem P. Kirenga
ACTING CHIEF EXECUTIVE

Encl: As stated

THE UNITED REPUBLIC OF TANZANIA
MINISTRY OF WORKS, TRANSPORT AND COMMUNICATION



UPGRADING OF MBINGA – MBAMBA BAY ROAD (66 KM) TO BITUMEN STANDARD

TENDER NO. AE/001/2015-16/HQ/W/54

Clarification No. 2 to the Bidding Documents

Date: 15th August, 2017

Clarification No. 2 to the Bidding Document is issued in accordance with Instructions to Bidders, Sub-Clause 7.1 of the Bidding documents:

Request No. 1 for Clarification:

- (i) BOQ Item 12.01 (c) Provision for drilling water supply boreholes, pumps, storage tanks, etc. It is noted that there is no dimensions and design for storage tanks. Please clarify the specifications for the storage tanks. Meanwhile, it is also noted that the quantity for items 12.01 (c) is 6, does this mean there will be six (6) storage tanks and six (6) boreholes respectively?
- (ii) BOQ Item 26.03 (a) Galvanized Gabion boxes (1.0m x 1.0m x 4.0m mesh size 60mm x 80mm). The quantity 61,000 m³ seems high for the intended project; hence could you please clarify whether the quantity is correct?

Response:

- (i) *The volume of tanks according to Clause SS.1219 of the Special Specifications is as follows: Overhead Water Storage Tanks (2 no.), each of volume 10,000 Litres; and Ground Water Tanks (4 no.), each of volume 25,000 Litres. Bidders are allowed to propose dimensions and specifications of the tanks for approval by the Engineer. However, the overhead tanks should be at a height of at least eight (8) metres from the ground level, unless instructed otherwise by the Engineer.*

There will be six (6) boreholes and six (6) storage tanks, i.e. for each borehole, there will be one storage tank.

- (ii) *Bidders should price as per the Revised BOQ.*

Amelle